

## Evaluating the **ADP5003** Low Noise Micro PMU, 3 A Buck Regulator with 3 A LDO

### FEATURES

- PVIN1 input voltage range: 4.2 V to 15 V
- Buck output voltage: 2.5 V (programmable from 0.6 V to 5.0 V)
- PVIN2 Input voltage range: 0.65 V to 5 V
- LDO output voltage: 1.8 V (programmable from 0.6 V to 3.3 V)

### EVALUATION KIT CONTENTS

ADP5003CP-EVALZ evaluation board

### ADDITIONAL EQUIPMENT NEEDED

- DC power supply for the PVIN1 and PVIN2 pins
- Multimeters for voltage and current measurements
- Electronic or resistive loads

### GENERAL DESCRIPTION

The ADP5003CP-EVALZ evaluation board demonstrates the functionality of the **ADP5003** dc-to-dc converter and low noise low dropout regulator (LDO).

Use the ADP5003CP-EVALZ to evaluate simple device measurements such as line regulation, load regulation, and efficiency. Device features include the buck regulator in fixed output or in adaptive headroom control and syncing the operating frequency to the external clock.

A full description of the **ADP5003** is available in the **ADP5003** data sheet and should be consulted when using this evaluation board.

### PHOTOGRAPH OF THE ADP5003CP-EVALZ EVALUATION BOARD

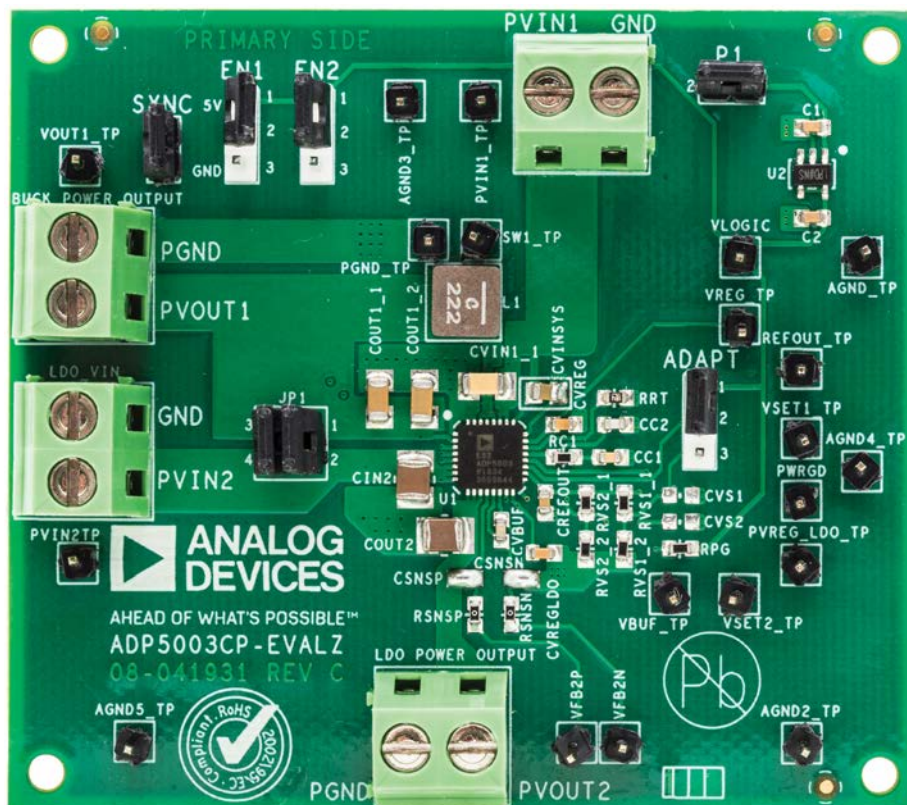


Figure 1.

**TABLE OF CONTENTS**

Features .....	1	Output Voltage Measurements .....	6
Evaluation Kit Contents.....	1	Line Regulation.....	6
Additional Equipment Needed .....	1	Load Regulation .....	7
General Description .....	1	Efficiency .....	7
Photograph of the ADP5003CP-EVALZ Evaluation Board .....	1	Evaluation Board Configuration .....	8
Revision History .....	2	Adaptive Headroom Control Setup .....	8
Evaluation Board Hardware.....	3	Fixed Output Setup with Cascaded Regulators.....	8
Evaluation Board Configurations .....	3	Evaluation Board Schematics and Artwork.....	9
Measurement Setup.....	5	Ordering Information.....	12
Buck Measurements .....	5	Bill of Materials.....	12
LDO Measurements .....	5		

**REVISION HISTORY**

**11/2017—Revision 0: Initial Version**

# EVALUATION BOARD HARDWARE

## EVALUATION BOARD CONFIGURATIONS

The ADP5003CP-EVALZ evaluation board is configured to provide a 1.8 V LDO output from a 4.2 V to 15 V input. To achieve this, the dc-to-dc regulator is configured to a 2.5 V output in fixed output mode or, when the ADAPT jumper is shorted, an output voltage that adaptively follows the LDO output voltage according to the load current.

Table 1 lists the ADP5003CP-EVALZ functions and Table 2 lists the components for the ADP5003 board.

Figure 2 outlines the ADP5003CP-EVALZ features available to the user and its supporting components.

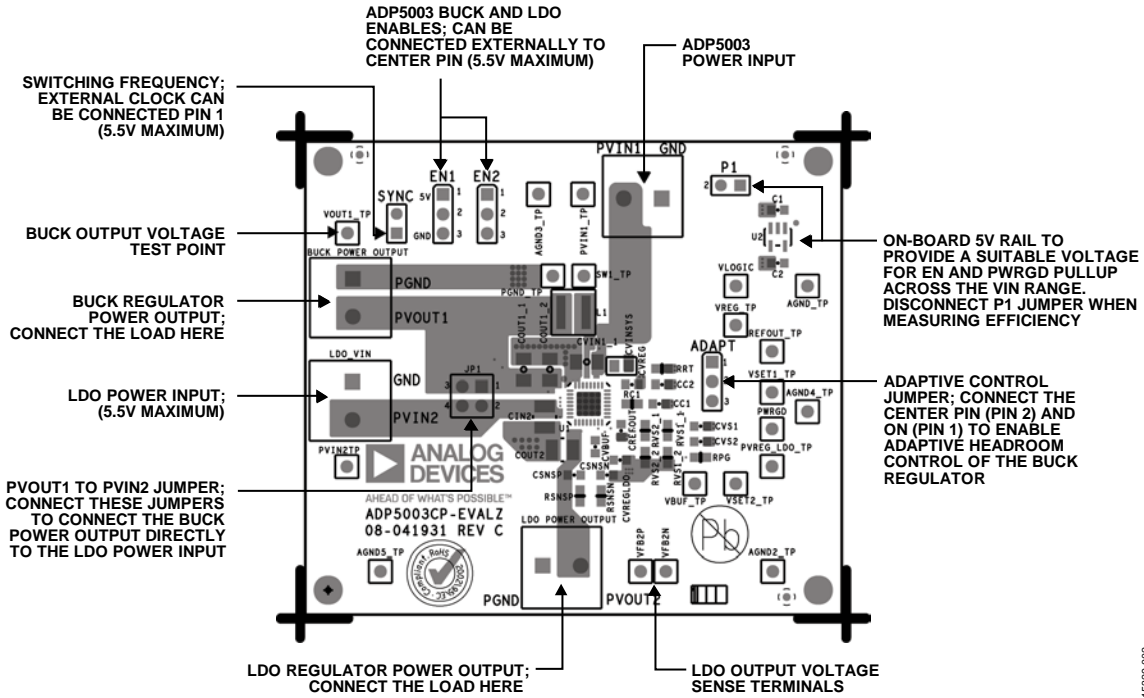


Figure 2. Outline of ADP5003 Evaluation Board Features

15328-002

Table 1. Evaluation Board Function Descriptions

Jumper/Connector Mnemonic	Description
PVIN1	ADP5003 power input screw terminal.
GND	Ground screw terminal.
PVIN1_TP	Test point for buck input voltage.
P1	Insert jumper to enable the on-board 5 V LDO. Disconnect this before implementing efficiency measurements and externally connect the 5 V voltage source to the enable pins.
VLOGIC	5 V pull-up voltage for enable pins and PWRGD.
EN1	Enable input jumper. Connect center pin to 5 V pin to enable the buck regulator.
EN2	Enable input jumper. Connect center pin to 5 V pin to enable the LDO regulator.
ADAPT	Jumper for adaptive headroom control. Connect the center pin to Pin 1 to activate the adaptive headroom control. Connect the center pin to Pin 3 to disable the adaptive headroom control.
SYNC	SYNC input pin. Connect an external clock to the bottom pin to sync the operating frequency.
BUCK POWER OUTPUT	Buck output screw terminal consisting of PVOU1 and PGND.
PVOU1	Buck power output.
VOUT1_TP	Sense pin test point for the buck output voltage.
PGND	Power ground for buck. This must always be connected to the power supply ground terminal.
JP1	Jumper to directly connect the buck output to the LDO input.
LDO_VIN	LDO input screw terminal consisting of PVIN2 and GND.
PVIN2TP	Test point for the LDO input voltage.
LDO POWER OUTPUT	LDO output screw terminal consisting of PVOU2 and PGND.
VFB2P	LDO positive remote sense pin. Remove the CSNSP solder bridge and connect this test point to the positive terminal of the load to enable remote sense.
VFB2N	LDO negative remote sense pin. Remove the CSNSN solder bridge and connect this test point to the negative terminal of the load to enable remote sense.

## MEASUREMENT SETUP

### BUCK MEASUREMENTS

Figure 3 shows the recommended setup to evaluate the buck regulator of the ADP5003CP-EVALZ. For accurate efficiency measurements, measure the input voltage between PVIN1\_TP and AGND3\_TP and the output voltage between VOUT1\_TP and AGND3\_TP.

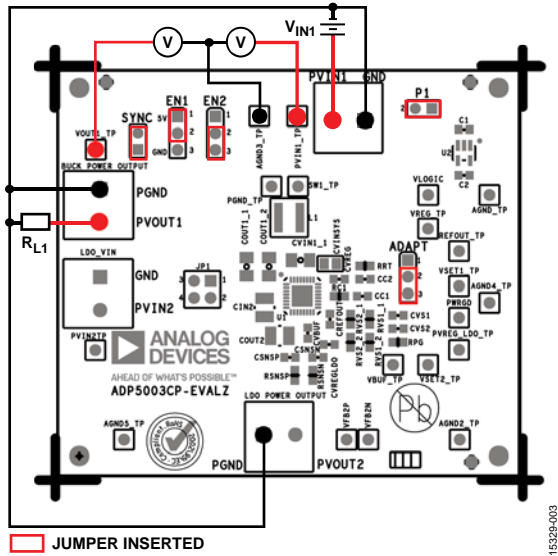


Figure 3. Buck Measurement Setup

### LDO MEASUREMENTS

Figure 4 shows the recommended setup to evaluate LDO regulator of the ADP5003CP-EVALZ. Output voltage measurements are always between the VFB2P and VFB2N pins, which serve as sense nodes and the input voltage between PVIN2TP and AGND5\_TP.

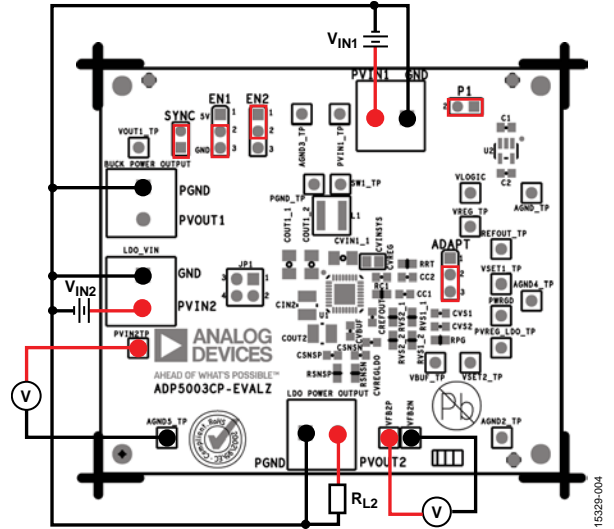


Figure 4. LDO Measurement Setup

## OUTPUT VOLTAGE MEASUREMENTS

For basic output voltage accuracy measurements, connect the ADP5003CP-EVALZ evaluation board to two voltage sources and a voltmeter. Use a resistive load for either regulators when possible. Ensure that the resistor has an adequate power rating to handle the expected power dissipation. Use an electronic load as an alternative. Ensure the voltage source supplies enough current for the expected load levels, accounting for device efficiency.

Follow these steps to connect the evaluation board to a voltage source and voltmeter:

1. Connect the negative terminal of the first voltage source to the GND screw terminal besides the PVIN1 screw terminal located at the upper side of the evaluation board.
2. Connect the positive terminal of the first voltage source to the PVIN1 screw terminal located at the upper side of the evaluation board.
3. Connect a load between the PVOOUT1 and PGND screw terminals at the BUCK POWER OUTPUT terminal block located at the left side of the evaluation board.
4. Connect the voltmeter across the PVIN1\_TP and AGND3\_TP test points.
5. Connect the voltmeter across the VOUT1\_TP and AGND3\_TP test points.
6. Connect the negative terminal of the second voltage source to the GND screw terminal of the LDO\_VIN terminal block located at the left side of the evaluation board.
7. Connect the positive terminal of the second voltage source to the PVIN2 screw terminal of the LDO\_VIN terminal block located at the left side of the evaluation board.
8. Connect a load between the PVOOUT2 and PGND terminals at the LDO power output terminal located at the lower side of the evaluation board.
9. Connect the voltmeter across the VFB2P and VFB2N test points.

Turn on the voltage source for PVIN1 before turning on the voltage source for PVIN2. If the EN1 or EN2 jumper is in the 5V position, their respective regulator powers up.

At high loads, measure the input voltage between PVIN1\_TP and AGND3\_TP for the buck and PVIN2\_TP and AGND5\_TP for the LDO. Compensate for the voltage drop or use a power supply with a 4-wire supply and sense arrangement.

## LINE REGULATION

For line regulation measurements, monitor the regulator output while its input is varied. For good line regulation, the output must change as little as possible with varying input levels. It is possible to repeat this measurement under different load conditions. During line regulation tests, keep the power supply leads short and remove any additional input capacitor. Figure 5 and Figure 6 show the typical line regulation performance of the ADP5003 at the buck output and LDO sense pins, respectively.

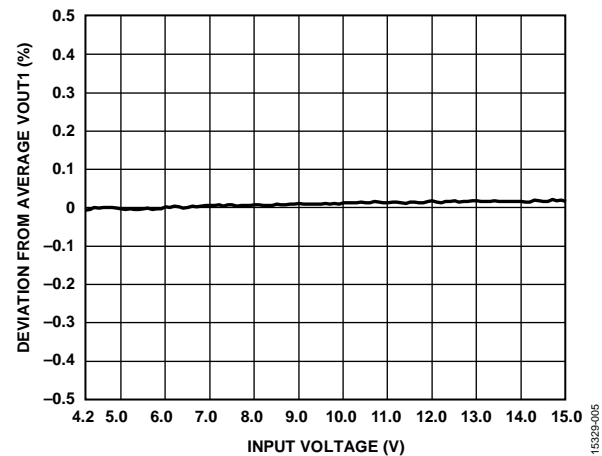


Figure 5. Buck Line Regulation

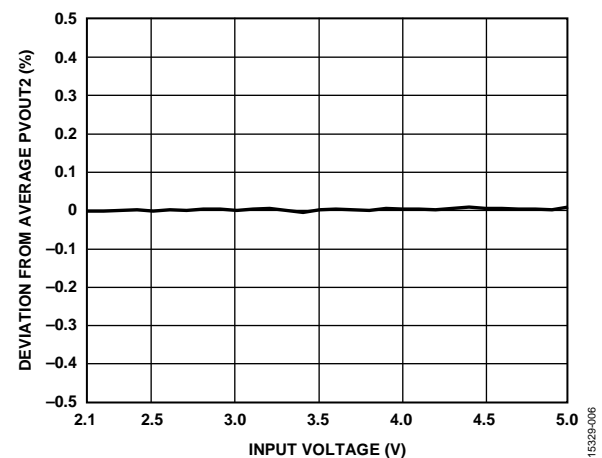


Figure 6. LDO Line Regulation

**LOAD REGULATION**

For load regulation measurements, monitor the regulator output while the load is varied. For good load regulation, the output must change as little as possible with varying loads. The input voltage must be held constant during this measurement. Figure 7 and Figure 8 show the typical load regulation performance of the ADP5003 at the buck output and LDO sense pins, respectively. Keep power leads short during this test and compensate for voltage drops at the input or use a power supply with remote sense.

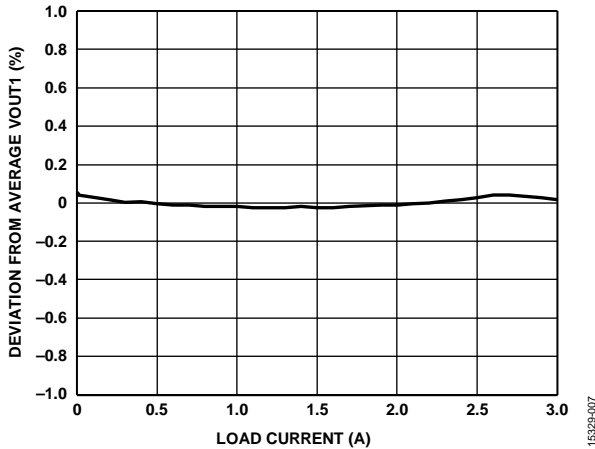


Figure 7. Buck Load Regulation

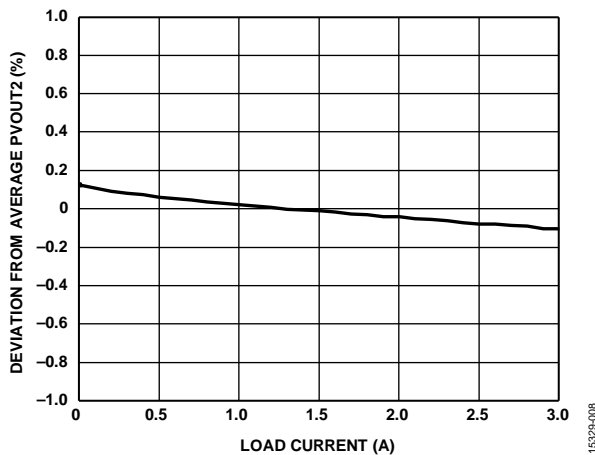


Figure 8. LDO Load Regulation

**EFFICIENCY**

For efficiency measurements, monitor the regulator input and output while the load is varied. The input voltage must be held constant during this measurement. Keep power leads short during this test and compensate for voltage drops at the input or use a power supply with remote sense. Connect ammeters in series with the input and output. Connect the voltmeters to their respective test points. If possible, particularly at low current, trigger the meters simultaneously and set to average readings for a period of a few hundred milliseconds or more. Figure 9 and Figure 10 show typical efficiency curves for a standalone buck and adaptive mode respectively.

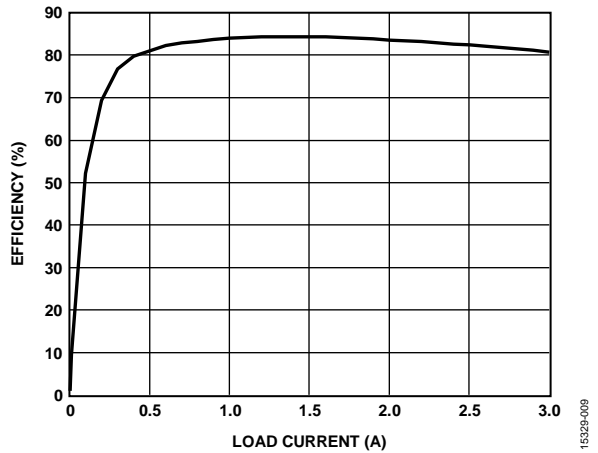


Figure 9. Buck Efficiency

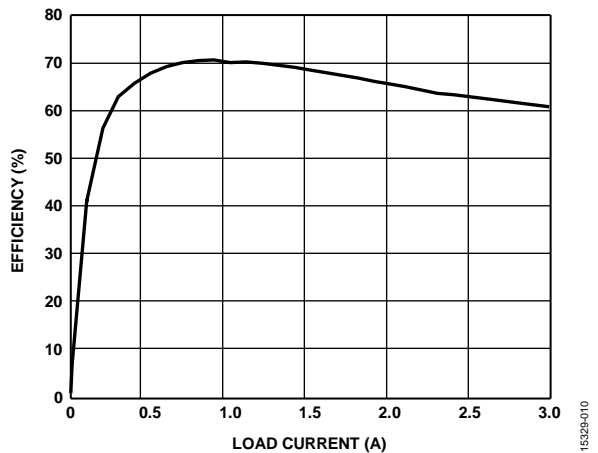


Figure 10. Adaptive Mode Efficiency




## EVALUATION BOARD CONFIGURATION

### ADAPTIVE HEADROOM CONTROL SETUP

The ADP5003CP-EVALZ evaluation board can be configured to operate in adaptive headroom control (see Figure 11) to provide a single step down voltage from PVIN1.

In this configuration, VSET1 is tied to VREG which activates the adaptive headroom control. When the buck is configured for adaptive headroom control, the ADP5003 manages the buck regulator output voltage depending on the LDO load current. The headroom profile of the adaptive headroom control delivers a consistent power supply rejection ratio (PSRR) across the load range while optimising efficiency of the overall system.

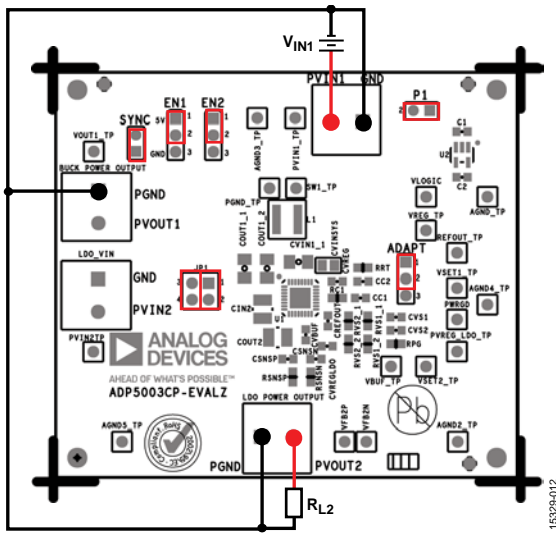





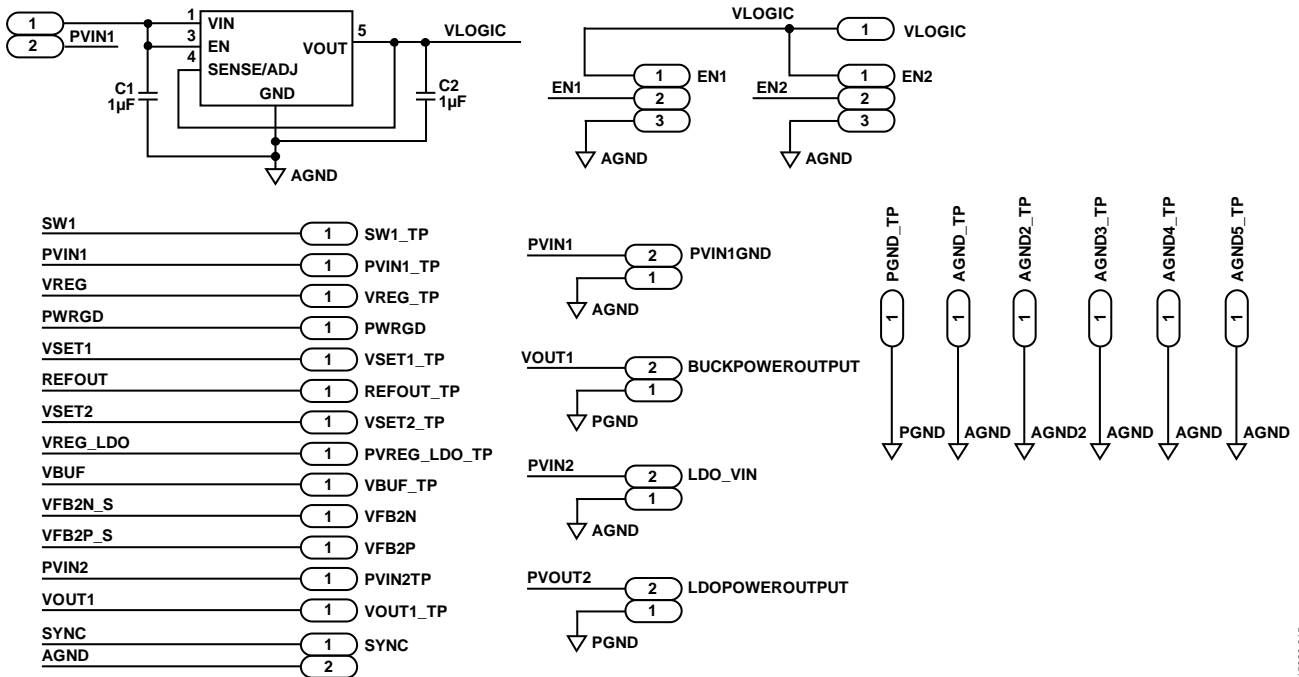


Figure 14. ADP5003CP-EVALZ Evaluation Board Schematic Connectors and Peripherals

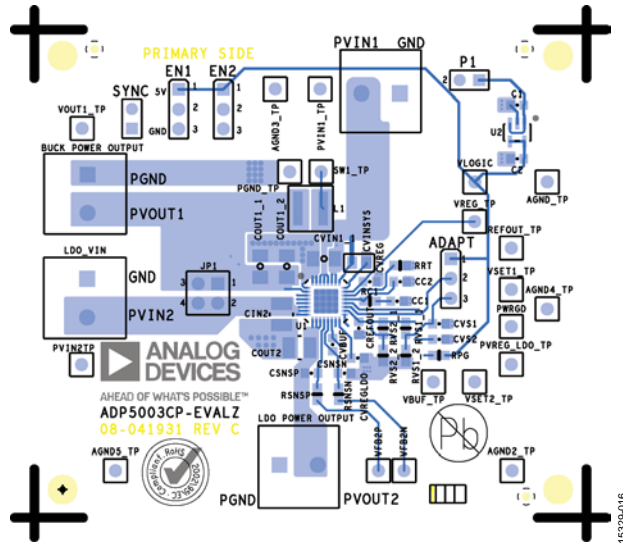


Figure 15. ADP5003CP-EVALZ Evaluation Board Top Layer

15329-015

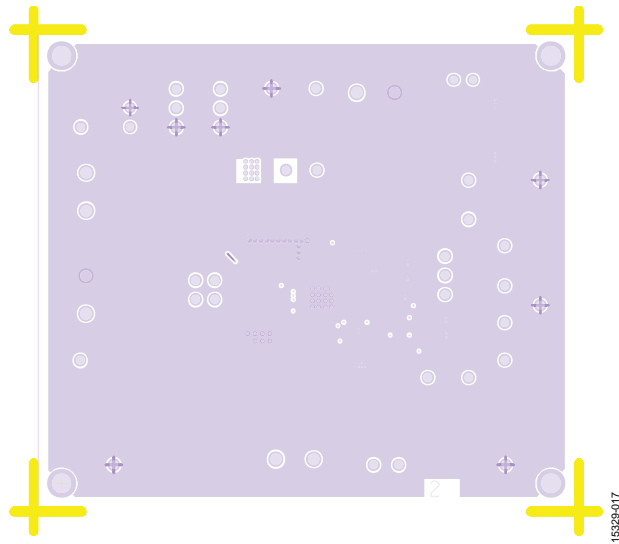


Figure 16. ADP5003CP-EVALZ Evaluation Board 2nd Layer

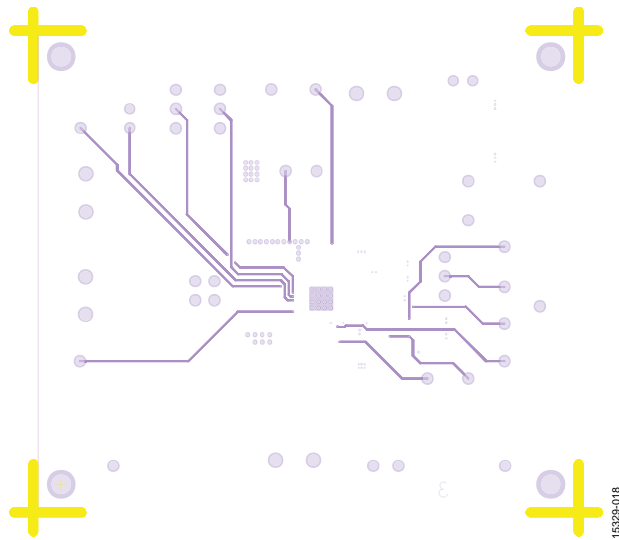


Figure 17. ADP5003CP-EVALZ Evaluation Board 3rd Layer

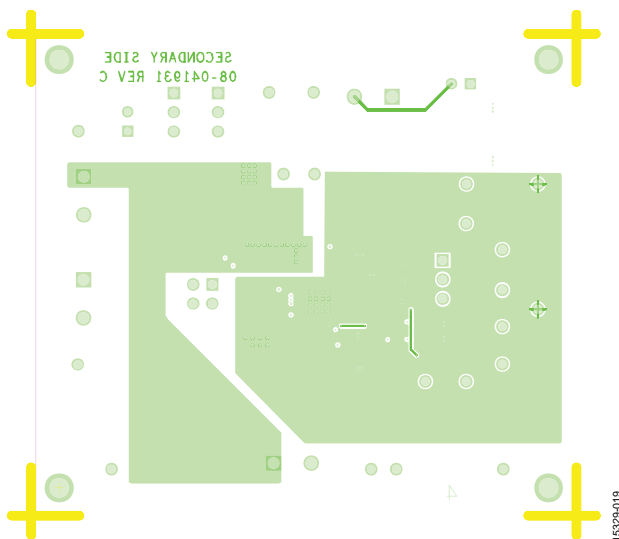


Figure 18. ADP5003CP-EVALZ Evaluation Board Bottom Layer

## ORDERING INFORMATION

## BILL OF MATERIALS

Table 2. Evaluation Board Components—ADP5003

Component	Description	Part Number	Manufacturer
U1	ADP5003, low noise, micro power management unit (PMU), 3 A buck regulator with 3 A LDO	ADP5003CP	Analog Devices, Inc.
CVIN1_1	V <sub>PVIN1</sub> capacitor, 1206, 10 μF, 10%, 25 V	GRM31CR61E106KA12L	Murata
CVINSYS	V <sub>PVINSYS</sub> capacitor, 0805, 4.7 μF, 10%, 25 V	GRM21BR61E475KA12L	Murata
COUT1_1, COUT1_2	V <sub>VOUT1</sub> capacitor, 1206, 22 μF, 10%, 16 V	1206YD2266KAT2A	AVX
L1	V <sub>VOUT1</sub> inductor, XAL5030, 2.2 μH, 20%	XAL5030-222ME	Coilcraft
CC1	Buck regulator compensation capacitor, 0603, 22 nF, 10%, 50 V	06035C223KAZ2A	AVX
CC2	Buck regulator compensation capacitor, 0603, 22 pF, 5%, 50 V	06035C220JAT2A	AVX
RC1	Buck regulator compensation resistor, 0603, 1.8 kΩ, 1%		
CIN2	V <sub>PVIN2</sub> capacitor, 1210, 10 μF, 10%, 63 V	GRM32ER71J106KA12L	Murata
COUT2	V <sub>PVOUT2</sub> capacitor, 1210, 10 μF, 10%, 63 V	GRM32ER71J106KA12L	Murata
RVS1_1	V <sub>VSET1</sub> top resistor, 0603, 49.9 kΩ, 1%		
RVS1_2	V <sub>VSET1</sub> bottom resistor, 0603, 49.9 kΩ, 1%		
RVS2_1	V <sub>VSET2</sub> top resistor, 0603, 43.2 kΩ, 1%		
RVS2_2	V <sub>VSET2</sub> bottom resistor, 0603, 52.3 kΩ, 1%		
CVREG	V <sub>VREG</sub> capacitor, 0603, 1 μF, 10%, 10 V	GRM188R71A105KA61D	Murata
CVREG_LDO	V <sub>VREG_LDO</sub> capacitor, 0603, 1 μF, 10%, 10 V	GRM188R71A105KA61D	Murata
CVREFOUT	V <sub>VREFOUT</sub> capacitor, 0603, 220 nF, 10%, 10 V	0603ZC224KAT2A	AVX
CVBUF	V <sub>VBUF</sub> capacitor, 0603, 100 nF, 10%, 16 V	CC0603KRX7R7BB104	Yageo
RRT	R <sub>RRT</sub> resistor, 0805, 180 kΩ, 1%		
CSNSP	Solder bridge, LDO positive sense return		
CSNSN	Solder bridge, LDO negative sense return		
RSNSP	V <sub>VFB2P</sub> sense resistor, 0 Ω, 0603		
RSNSN	V <sub>VFB2N</sub> sense resistor, 0 Ω, 0603		
U2	ADP7118, high voltage LDO with 5 V output voltage, thin shrink small outline package (TSSOP)	ADP7118AUJZ-5.0	Analog Devices, Inc.
C1	V <sub>VIN</sub> capacitor, 0603, 1 μF, 10%, 10 V	GRM188R71A105KA61D	Murata
C2	V <sub>VLOGIC</sub> capacitor, 0603, 1 μF, 10%, 10 V	GRM188R71A105KA61D	Murata
RPG	PWRGD pull-up resistor, 0603, 49.9 kΩ, 1%		

**ESD Caution**

**ESD (electrostatic discharge) sensitive device.** Charged devices and circuit boards can discharge without detection. Although this product features patented or proprietary protection circuitry, damage may occur on devices subjected to high energy ESD. Therefore, proper ESD precautions should be taken to avoid performance degradation or loss of functionality.

**Legal Terms and Conditions**

By using the evaluation board discussed herein (together with any tools, components documentation or support materials, the "Evaluation Board"), you are agreeing to be bound by the terms and conditions set forth below ("Agreement") unless you have purchased the Evaluation Board, in which case the Analog Devices Standard Terms and Conditions of Sale shall govern. Do not use the Evaluation Board until you have read and agreed to the Agreement. Your use of the Evaluation Board shall signify your acceptance of the Agreement. This Agreement is made by and between you ("Customer") and Analog Devices, Inc. ("ADI"), with its principal place of business at One Technology Way, Norwood, MA 02062, USA. Subject to the terms and conditions of the Agreement, ADI hereby grants to Customer a free, limited, personal, temporary, non-exclusive, non-sublicensable, non-transferable license to use the Evaluation Board FOR EVALUATION PURPOSES ONLY. Customer understands and agrees that the Evaluation Board is provided for the sole and exclusive purpose referenced above, and agrees not to use the Evaluation Board for any other purpose. Furthermore, the license granted is expressly made subject to the following additional limitations: Customer shall not (i) rent, lease, display, sell, transfer, assign, sublicense, or distribute the Evaluation Board; and (ii) permit any Third Party to access the Evaluation Board. As used herein, the term "Third Party" includes any entity other than ADI, Customer, their employees, affiliates and in-house consultants. The Evaluation Board is NOT sold to Customer; all rights not expressly granted herein, including ownership of the Evaluation Board, are reserved by ADI. CONFIDENTIALITY. This Agreement and the Evaluation Board shall all be considered the confidential and proprietary information of ADI. Customer may not disclose or transfer any portion of the Evaluation Board to any other party for any reason. Upon discontinuation of use of the Evaluation Board or termination of this Agreement, Customer agrees to promptly return the Evaluation Board to ADI. ADDITIONAL RESTRICTIONS. Customer may not disassemble, decompile or reverse engineer chips on the Evaluation Board. Customer shall inform ADI of any occurred damages or any modifications or alterations it makes to the Evaluation Board, including but not limited to soldering or any other activity that affects the material content of the Evaluation Board. Modifications to the Evaluation Board must comply with applicable law, including but not limited to the RoHS Directive. TERMINATION. ADI may terminate this Agreement at any time upon giving written notice to Customer. Customer agrees to return to ADI the Evaluation Board at that time. LIMITATION OF LIABILITY. THE EVALUATION BOARD PROVIDED HEREUNDER IS PROVIDED "AS IS" AND ADI MAKES NO WARRANTIES OR REPRESENTATIONS OF ANY KIND WITH RESPECT TO IT. ADI SPECIFICALLY DISCLAIMS ANY REPRESENTATIONS, ENDORSEMENTS, GUARANTEES, OR WARRANTIES, EXPRESS OR IMPLIED, RELATED TO THE EVALUATION BOARD INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTY OF MERCHANTABILITY, TITLE, FITNESS FOR A PARTICULAR PURPOSE OR NON-INFRINGEMENT OF INTELLECTUAL PROPERTY RIGHTS. IN NO EVENT WILL ADI AND ITS LICENSORS BE LIABLE FOR ANY INCIDENTAL, SPECIAL, INDIRECT, OR CONSEQUENTIAL DAMAGES RESULTING FROM CUSTOMER'S POSSESSION OR USE OF THE EVALUATION BOARD, INCLUDING BUT NOT LIMITED TO LOST PROFITS, DELAY COSTS, LABOR COSTS OR LOSS OF GOODWILL. ADI'S TOTAL LIABILITY FROM ANY AND ALL CAUSES SHALL BE LIMITED TO THE AMOUNT OF ONE HUNDRED US DOLLARS (\$100.00). EXPORT. Customer agrees that it will not directly or indirectly export the Evaluation Board to another country, and that it will comply with all applicable United States federal laws and regulations relating to exports. GOVERNING LAW. This Agreement shall be governed by and construed in accordance with the substantive laws of the Commonwealth of Massachusetts (excluding conflict of law rules). Any legal action regarding this Agreement will be heard in the state or federal courts having jurisdiction in Suffolk County, Massachusetts, and Customer hereby submits to the personal jurisdiction and venue of such courts. The United Nations Convention on Contracts for the International Sale of Goods shall not apply to this Agreement and is expressly disclaimed.

©2017 Analog Devices, Inc. All rights reserved. Trademarks and registered trademarks are the property of their respective owners.  
UG15329-0-11/17(0)



[www.analog.com](http://www.analog.com)